


Sulfuric Acid and Hydrochloric Acid  
Dew-point Corrosion-resistant Steel

# S-TEN™

Technical Document

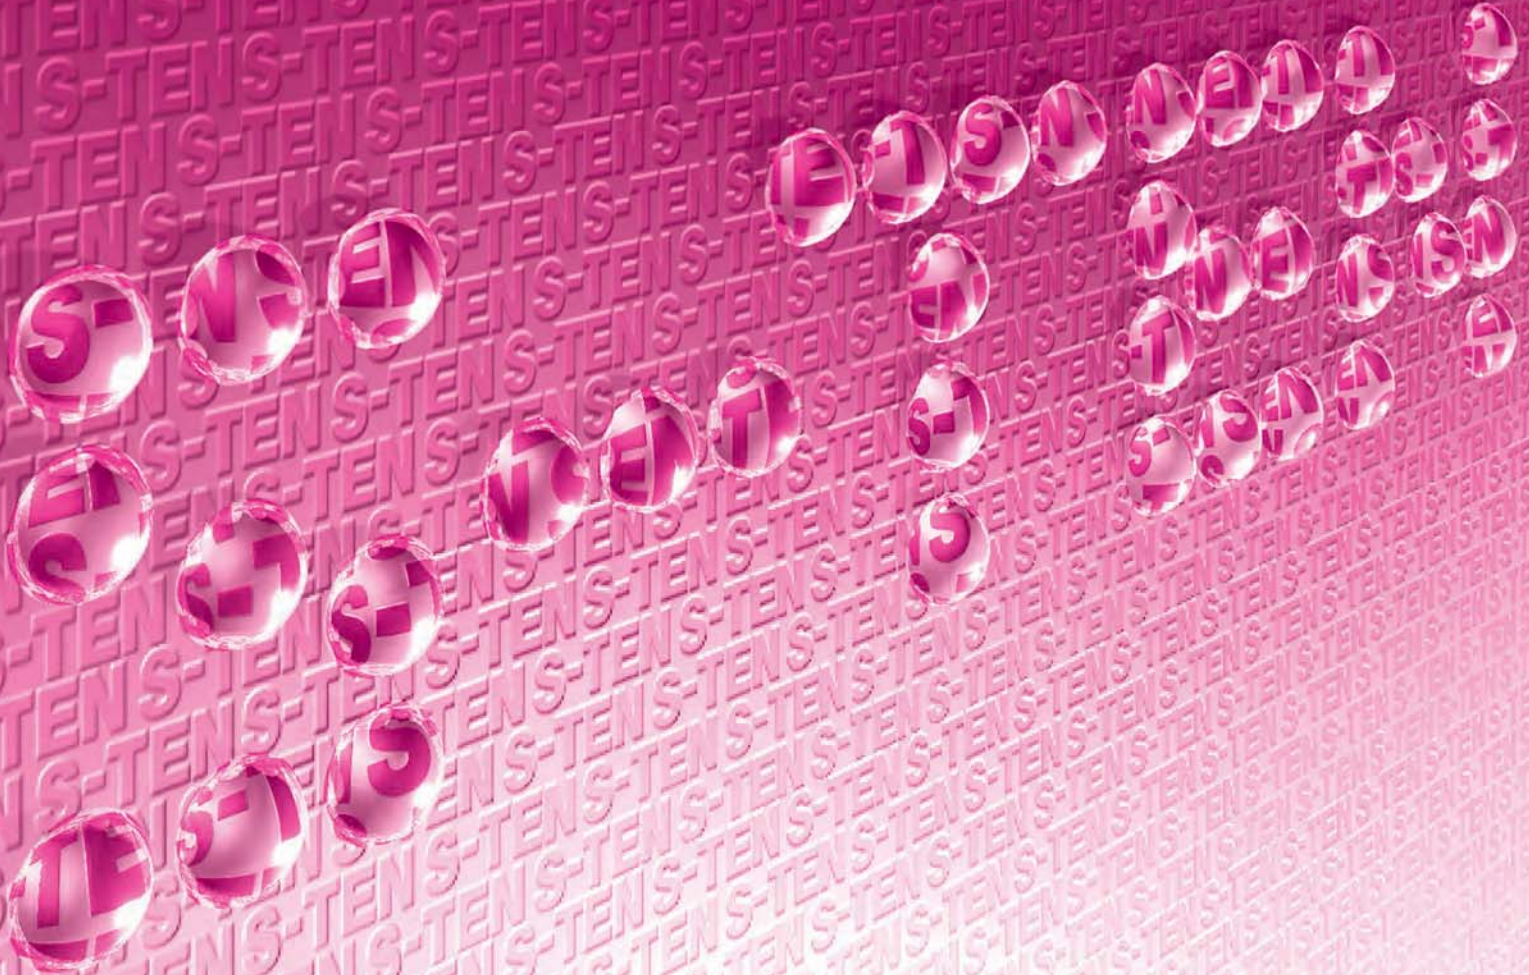

**NIPPON STEEL &  
SUMITOMO METAL**

## Features

- ◆ **S-TEN is a sulfuric acid and hydrochloric acid dew-point corrosion-resistant steel developed by NSSMC using proprietary technology.**
  - S-TEN exhibits the best resistance to sulfuric acid and hydrochloric acid dew-point corrosion found in the flue-gas treatment equipment used with coal-fired boilers, waste incineration plants, etc. (This steel has the finest application record in the field of thermal power generation and waste incineration plants, according to surveys conducted by NSSMC)
  - S-TEN was awarded the Ichimura Industrial Award Achievement Award in 2007
- ◆ **S-TEN has strength, workability and weldability that are comparable to ordinary steel.**
- ◆ **S-TEN is more economical than stainless steel.**
- ◆ **S-TEN offers a rich product line ranging from hot-rolled sheets (plates), cold-rolled sheets and pipe and tubes to welding materials.**
  - Hot-rolled sheets (plates) conform to JIS G 3106 SM400A (S-TEN 1) and SM490A (S-TEN 2).
- ◆ **S-TEN products are easily available because they are constantly stocked by retailers.**

NSSMC:Nippon Steel & Sumitomo Metal Corporation

## CONTENTS

### 1. Characteristics of S-TEN

Sulfuric Acid and Hydrochloric Acid Dew-point Corrosion .....	1
Advantages of S-TEN .....	2
Examinations in Applying S-TEN .....	3
Application Examples for S-TEN .....	6
Precautions in the Use of S-TEN .....	7

### 2. Specifications and Available Sizes of S-TEN

Specifications of S-TEN .....	8
Available Sizes for S-TEN .....	9

### 3. Characteristic Properties of S-TEN (Examples)

Chemical Composition and Mechanical Properties .....	11
High-Temperature Characteristics .....	11
Physical Properties .....	12
Corrosion Resistance .....	12

### 4. Welding of S-TEN

Welding Materials .....	14
Welding Characteristics .....	15
Sulfuric Acid and Hydrochloric Acid Resistance of Welded Joints .....	16
Galvanic Corrosion in Corrosive Atmosphere .....	17
Property Qualification Test Results .....	17

### 5. Application Examples

.....	18
-------	----

### 6. Reference

Unit Conversion Table .....	19
Unit Conversion Charts .....	20

**Notice:** While every effort has been made to ensure the accuracy of the information contained within this publication, the use of the information is at the reader's risk and no warranty is implied or expressed by Nippon Steel & Sumitomo Metal Corporation with respect to the use of the information contained herein. The information in this publication is subject to change or modification without notice. Please contact the Nippon Steel & Sumitomo Metal Corporation office for the latest information. Please refrain from unauthorized reproduction or copying of the contents of this publication.

The names of our products and services shown in this publication are trademarks or registered trademarks of Nippon Steel & Sumitomo Metal Corporation, affiliated companies, or third parties granting rights to Nippon Steel & Sumitomo Metal Corporation or affiliated companies. Other product or service names shown may be trademarks or registered trademarks of their respective owners.

# 1. Characteristics of S-TEN

## Sulfuric Acid and Hydrochloric Acid Dew-point Corrosion

Recently, environmental issues are becoming pressing concerns. In parallel with this, construction of tall smokestacks, air preheaters, electrostatic precipitators and flue-gas desulfurizers and other treatment equipment has shown great strides.

In the flue gas treatment process of plants using coal and oil as fuels, improvement of desulfurization efficiency is aimed, and as a result, low temperature corrosion due to sulfur oxide is a big problem.

The low-temperature section corrosion is the corrosion caused by high-temperature, highly-concentrated sulfuric acid, called sulfuric acid dew-point corrosion. This kind of corrosion differs from general atmospheric corrosion and causes heavy corrosion of not only ordinary steel but even stainless steel.

Further, because of the remarkable technological developments recently seen in dioxin countermeasures, flue-gas temperatures are increasingly being reduced from previous levels.

In conventional facilities where, formerly, only sulfuric acid dew-point corrosion occurred, there are now cases of hydrochloric acid dew-point corrosion that is caused by lower flue-gas temperatures resulting from remodeling with countermeasures against dioxins.


Developed to solve these problems is S-TEN – steel for welded structures, highly resistant to sulfuric acid and hydrochloric acid dew-point corrosion.

S-TEN 1 has effective resistance to both sulfuric acid dew point corrosion and hydrochloric acid dew point corrosion, while S-TEN 2 is effectively resistant to sulfuric acid dew point corrosion.

Grade	Sulfuric Acid Dew Point Corrosion Resistance	Hydrochloric Acid Dew Point Corrosion Resistance
S-TEN 1	○	○
S-TEN 2	○	—


○: Excellent

Fig. 1.1 Waste Incineration Facility: Mechanism of Sulfuric Acid and Hydrochloric Acid Dew-point Corrosion Occurring in Flue-gas Treatment System

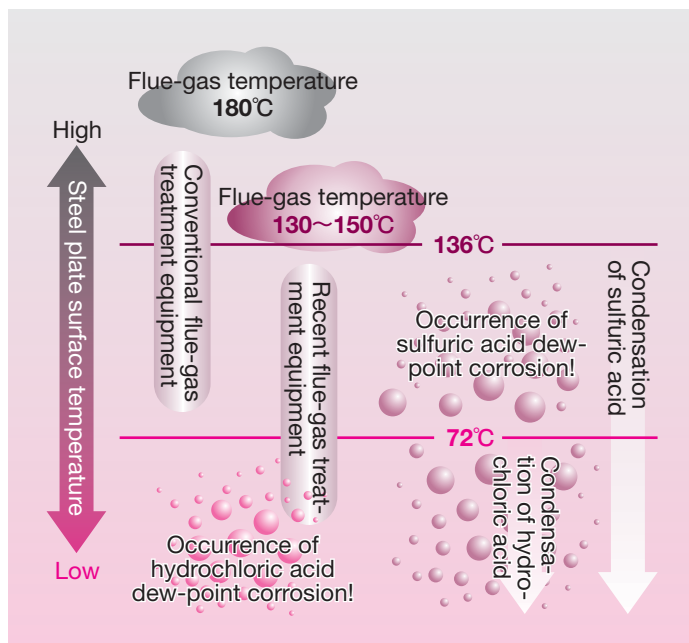

In the case of flue-gas composition ( $\text{SO}_3$ : 3 ppm,  $\text{HCl}$ : 300 ppm,  $\text{H}_2\text{O}$ : 30%)

Photo 1.1 Example of Hydrochloric Acid Dew-point Corrosion in Internal Cylinder of Stack

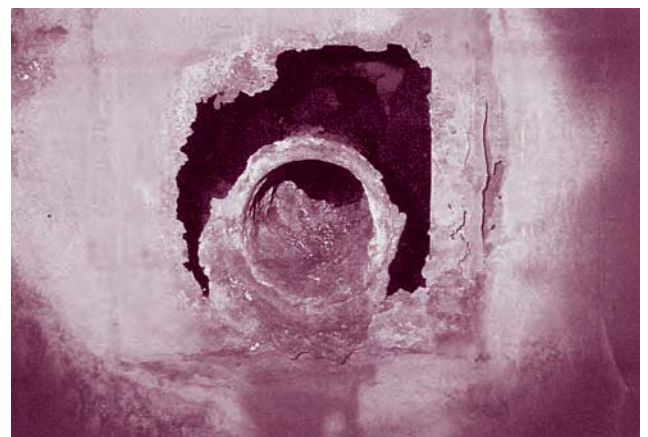

# 1. Characteristics of S-TEN

## Advantages of S-TEN

Ordinary or stainless steel cannot be used in applications in which sulfuric acid dew-point corrosion is a governing factor. Neither can weathering steels such as COR-TEN™ provide satisfactory performance in these applications.

The material appropriate for these applications is S-TEN.

Fig.1.6 shows the results of sulfuric acid immersion tests conducted under the conditions of temperature and concentration obtained from Fig.1.5.

Extremely severe corrosion occurs under the conditions of 70°C and 50% H<sub>2</sub>SO<sub>4</sub>. However, under such conditions, S-TEN exhibits corrosion resistance about five times greater than both ordinary steel and COR-TEN and about 10 times that of stainless steel. It is in such severe applica-

tion environments that S-TEN shows the best performance.


In this way, corrosion caused by high-temperature, highly concentrated sulfuric acid differs from common atmospheric corrosion. Not only ordinary steel but stainless steel, as well, is heavily corroded in environments of high-temperature, highly concentrated sulfuric acid (in some cases, exceeding a corrosion rate of 5 mm/year).

Fig.1.7 shows the clear differences in corrosion resistance demonstrated by ordinary steel, COR-TEN, and S-TEN during long-term tests conducted in actual 60% H<sub>2</sub>SO<sub>4</sub> or higher environments at 80°C with sufficient oxygen to produce sulfuric acid dew-point corrosion.


**Table 1.1 Chemical Composition of Test Specimens**

Grade (equivalent)	Chemical composition (%)									
	C	Si	Mn	P	S	Cu	Ni	Cr	Sb	Others
SUS 410 (13%Cr) (equivalent)	0.10	0.38	0.46	0.019	0.012	0.12	0.19	12.53	—	—
SUS 430 (18%Cr) (equivalent)	0.07	0.51	0.34	0.040	0.006	0.11	0.27	17.29	—	—
SUS 304 (18Cr-8Ni) (equivalent)	0.08	0.58	1.42	0.029	0.008	0.20	9.21	18.56	—	—
SUS 316 (18Cr-12Ni-2Mo) (equivalent)	0.08	0.68	1.62	0.030	0.008	0.24	11.72	17.05	—	Mo:2.20
Mild Steel	0.16	0.03	0.23	0.008	0.013	0.08	—	—	—	—
<b>S-TEN 1</b>	<b>0.03</b>	<b>0.28</b>	<b>0.91</b>	<b>0.011</b>	<b>0.009</b>	<b>0.27</b>	—	—	<b>0.10</b>	—
<b>S-TEN 2</b>	<b>0.10</b>	<b>0.21</b>	<b>0.75</b>	<b>0.014</b>	<b>0.012</b>	<b>0.36</b>	—	<b>0.63</b>	—	<b>Ti:0.04</b>
COR-TEN A	0.09	0.46	0.38	0.110	0.017	0.32	0.30	0.52	—	—

**Fig. 1.6 Sulfuric Acid Immersion Test Results under the Atmosphere-solution Equilibrium State of Sulfuric Acid and Hydrogen**

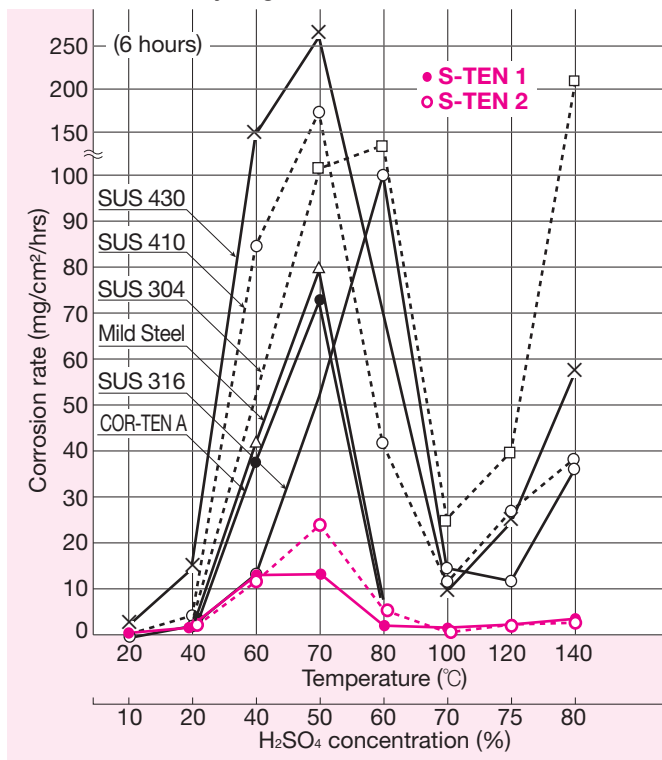

**Fig. 1.7 Corrosion Mass of Steel in H<sub>2</sub>SO<sub>4</sub>**

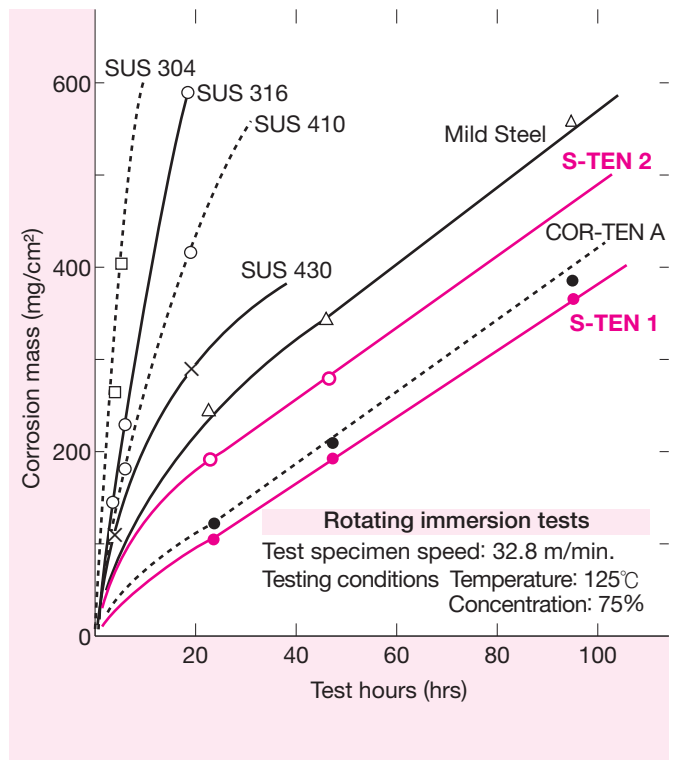

## Examinations in Applying S-TEN



Document the flue-gas composition (SO<sub>x</sub>, HCℓ, H<sub>2</sub>O). In cases when the gas composition varies widely depending on the combustion materials, adopt the maximum value for each composition.



Estimate the sulfuric acid dew point (temperature) from the flue-gas composition.

### For More Appropriate Use of S-TEN (Precaution in Use)

By combining the use of S-TEN with more appropriate equipment design, it is possible to minimize the cost of equipment repair and maintenance.

The following examines estimated corrosion environments and suitable grades of S-TEN for the casings of bag filters installed in general waste incineration plants.

By adhering to the following five steps, S-TEN can be more appropriately applied in waste incineration plants and environmental-protection equipment.

Table 1.2

	H <sub>2</sub> O (vol%)	SO <sub>3</sub> (ppm)	HCℓ (ppm)
Average value <sup>1)</sup>	30	3	300
Maximum value <sup>2)</sup>	50	10	1,000

Notes 1) The case when the variation of combustion is small

2) The case when the variation of combustion is large, or the estimation of the variation of combustion is difficult

In this example, it is estimated that the variation in combustion is small, so the average value is adopted for the next step.

When the values for SO<sub>3</sub> (3 ppm) and H<sub>2</sub>O (30%) shown in Table 1.2 are applied to the table of sulfuric acid dew points (Table 1.3), the target sulfuric acid dew point is seen to be approximately 136°C.

Table 1.3 Table of Sulfuric Acid Dew-point Temperature of SO<sub>3</sub>-H<sub>2</sub>O-type Gas

SO <sub>3</sub> in gas (Volume ppm)	Moisture in gas (vol%)											
	5	10	15	20	25	30	35	40	45	50	55	60
0.0	33	46	53	60	66	69	74	76	79	81	84	87
0.1	87	95	100	103	106	108	111	112	114	115	117	118
1	106	114	119	122	125	127	129	130	132	133	134	135
2	113	120	125	128	131	133	134	136	137	139	140	141
3	117	124	128	132	134	136	138	139	141	142	143	144
4	119	127	131	134	137	139	140	142	143	145	146	147
5	122	129	133	136	139	141	142	144	145	146	148	149
6	123	131	135	138	140	142	144	146	147	148	149	150
7	125	132	136	139	142	144	145	147	148	149	150	151
8	126	133	138	141	143	145	147	148	149	151	152	153
9	127	134	139	142	144	146	148	149	150	152	153	154
10	129	135	140	143	145	147	149	150	151	153	154	155
20	136	142	146	149	152	153	155	156	158	159	160	161
30	140	147	150	153	155	157	159	160	161	162	163	164
40	143	150	153	156	158	160	162	163	164	165	166	167
50	146	152	156	158	161	162	164	165	166	167	168	169
60	148	154	158	160	162	164	166	167	168	169	170	171
70	149	156	159	162	164	166	167	168	169	171	171	172
80	151	157	161	163	165	167	168	170	171	172	173	174
90	152	158	162	164	167	168	170	171	172	173	174	175
100	154	159	163	166	168	169	171	172	173	174	175	176
200	162	167	171	173	175	176	178	179	180	181	182	182
300	167	172	175	177	179	181	182	183	184	185	186	187
400	170	175	178	181	182	184	185	186	187	188	189	189
500	173	178	181	183	185	186	188	189	189	190	191	192

Key points in design

1) In the case of identical dew point, corrosion mass is nearly proportional to SO<sub>3</sub> amount.

2) In the case of SO<sub>3</sub> ≥ 100 ppm, the corrosion rate increases even in S-TEN, and thus cares should be paid to its application.

## 1. Characteristics of S-TEN



**Find the hydrochloric acid dew point from the flue-gas composition.**

The hydrochloric acid dew point is based on the moisture (H<sub>2</sub>O) and hydrogen chloride (HCl) contained in the flue gas and is found by employing the table of hydrochloric acid dew points (Table 1.4) and other data.

For the structural parts that constantly enter the light blue area of the table, a number of dilute hydrochloric-acid drains are formed that lead to increased corrosion. As a result, S-TEN with acid-resistant coating is recommended.

When the values for HCl (300 ppm) and H<sub>2</sub>O (30%) shown in Table 1.2 are applied to the table of hydrochloric acid dew points (Table 1.4), the target hydrochloric acid dew point is seen to be approximately 72°C.

**Table 1.4 Table of Sulfuric Acid Dew-point Temperature of HCl-H<sub>2</sub>O-type Gas**

Hydrogen chloride in gas (Volume ppm)	Moisture in gas (vol%)											
	5	10	15	20	25	30	35	40	45	50	55	60
1	33	46	53	60	66	69	74	76	79	81	84	87
10	33	46	53	60	66	69	74	76	79	81	84	87
20	34	46	53	60	66	69	74	76	79	81	84	87
30	35	47	54	60	66	69	74	76	79	81	84	87
40	36	47	55	60	66	69	74	76	79	81	84	87
50	36	48	55	60	66	69	74	76	79	81	84	87
60	37	48	56	61	66	69	74	76	79	81	84	87
70	37	49	56	61	66	69	74	76	79	81	84	87
80	37	49	56	61	66	69	74	76	79	81	84	87
100	38	49	57	62	66	70	74	76	79	81	84	87
200	39	51	58	63	68	71	74	77	79	81	84	87
300	40	52	59	64	68	72	75	78	80	82	84	87
400	41	52	60	65	69	73	76	78	81	83	85	87
500	42	53	60	65	70	73	76	79	81	83	85	87
600	42	53	61	66	70	73	76	79	81	84	86	87
700	42	54	61	66	70	74	77	79	82	84	86	88
800	43	54	61	66	71	74	77	80	82	84	86	88
900	43	54	61	67	71	74	77	80	82	84	86	88
1,000	43	55	62	67	71	75	78	80	83	85	87	88
2,000	45	56	63	68	73	76	79	82	84	86	88	90
3,000	46	57	64	69	73	77	80	83	85	87	89	91
4,000	46	58	65	70	74	78	81	83	86	88	90	91
5,000	47	58	65	70	75	78	81	84	86	88	90	92
10,000	48	60	67	72	76	80	83	85	88	90	92	93

Key points in design

- : 1) Water dew point
  - 2) When operations are constantly conducted within this temperature range, a quantity of dilute hydrochloric acid drains are forecasted to generate.
  - 3) Provision of countermeasures against drains is required.
  - 4) Sulfuric acid dew-point corrosion-resistant steel S-TEN with acid-resistant coating is recommended.
  
- : 1) Hydrochloric acid dew point
  - 2) High-concentration hydrochloric acid condensates.
  - 3) Sulfuric acid and hydrochloric acid dew-point corrosion-resistant steel S-TEN 1 is recommended.



Based on the features of the equipment under examination, find the surface temperature of the structural members that are exposed to the flue gas.

In the case of the current bag filter casing, external heat insulation is to be provided. Also, the temperature of the flue gas passing through the equipment is to be set at 150°C.

When referring to Table 1.5, the temperature of the steel plate surfaces is estimated as follows:

- The section with effective external heat insulation: about 130°C
- The section with less effective external heat insulation: 80~100°C

Table 1.5 Approximate Criteria for Wall Surface Temperature

External wall of flue, stack internal cylinder, duct, casing, etc. (In the case of flue-gas temperature at nearly 150°C)	In the case of provision of external heat insulation	Flue-gas temperature: nearly -20°C (However, in the case of structurally conducting radiation: -50~-70°C)
	In the case of no provision of external heat insulation	Flue-gas temperature: -50~-70°C
Element, etc. of air heater	Intermediate temperature between temperatures of flue gas and air	
Electrostatic precipitator electrode, etc. in the flue gas	Same as the temperature of flue gas	
Heat exchanger tube using steam and hot water as steam or hot water	Same as the temperature of steam or hot water	



Select the most suitable material and corrosion-protection specifications from the hydrochloric acid dew point, sulfuric acid dew point and estimated surface temperature of the structural member.

When summarizing the above, the following facts can be understood:

- Flue-gas temperature: about 150°C
- Sulfuric acid dew point: 136°C
- Hydrochloric acid dew point: 72°C
- Steel plate (wall surface) temperature (external heat insulation is to be provided): 80°C or more at minimum

When referring to Table 1.6, it is understood that S-TEN 1 is most suitable for this case. Further, because the estimated temperature at the radiation section (80°C) is close to the hydrochloric acid dew point (72°C), it is seen that unexpected and excessive corrosion can be prevented if due attention is paid to the design so that radiation is avoided.

Table 1.6 Selection of Suitable Grades of S-TEN Applied in Waste Incineration Plants and Flue-gas Treatment System of Environmental Equipment

Flue-gas temperature	Range of wall surface temperature	Examples of equipment	Operating method		Reference (Corrosion mass)
			Continuous operation	Batch operation	
350°C or more	500°C or more		<b>S-TEN: Not suitable</b>		—
	350~500°C	Duct in front of gas cooler	<b>S-TEN 2</b>	<b>S-TEN 2</b>	In operation: 0.3 mm/yr or less At start and stop: 2~3µm/start and stop
Less than 350°C	350°C~Sulfuric acid dew point	Gas cooler	<b>S-TEN 1</b> <b>S-TEN 2</b>	<b>S-TEN 1</b> <b>S-TEN 2</b>	In operation: 0.1 mm/yr or less At start and stop: 2~3µm/start and stop
	Sulfuric acid dew point~Hydrochloric acid dew point	Gas cooler, bag filter casing, air preheater, flue stack	<b>S-TEN 1</b>	<b>S-TEN 1</b>	About 0.2 mm/yr
Less than Sulfuric acid dew point	Hydrochloric acid dew point~Water dew point	Flue Stack	<b>S-TEN 1</b>	<b>S-TEN 1</b>	About 0.2 mm/yr

## 1. Characteristics of S-TEN

### Application Examples for S-TEN

Table 1.7 Examples of Applications of S-TEN


Equipment	Practical application examples				Precautions in use
	Application	Grade		Approximate plate thickness (mm)	
		S-TEN 1	S-TEN 2		
Dry-type electrostatic precipitator	Casing, duct, collecting electrode	○	○	1.2~8	The temperature of casings and ducts is 20~70°C lower than that of flue gas, depending on the heat insulation conditions. It is estimated that the temperature of the collecting electrode and the gas is the same. In cases when dust accumulates, the absorbed H <sub>2</sub> SO <sub>4</sub> is difficult to evaporate and leads to cases of more than expected corrosion. As a result, it is necessary to prevent dust accumulation.
Wet-type electrostatic precipitator	Casing, duct, collecting electrode	○	○	3.2~12	In cases when the flow of scrubber water is constant against a wall surface, the corrosion mass increases (by 0.1 mm/yr on one side). Further, in cases when the scrubber water in such a situation has a low pH value, the corrosion mass will increase abruptly, thereby making it necessary to avoid the use of S-TEN.
Gas cooler	Casing, duct	○	○	4.5~9	The temperature of casings and ducts is 20~70°C lower than that of flue gas, depending on the heat insulation conditions. The mist droplet becomes large due to the deterioration of nozzle holes and does not evaporate to reach the casing, under which there are cases when unexpected corrosion occurs, and thus it is necessary to control the deterioration of nozzle holes.
	Ash discharge blade	—	○	12~20	S-TEN 2 is most suitable for use as the material for the blades that discharge the ash accumulated in the bottom section of gas cooler. The stress-induced corrosion cracking attributable to the chlorides contained in the ash can be prevented from occurring.
Air preheater	Ljungström-type basket case, element	○	○	0.6~6	Because of repeated fluctuations in wall surface temperature, dew-point corrosion from high to low temperatures occurs repeatedly, and the application advantage of S-TEN is exhibited to the high degree.
	Tube	○	—	0.6~3.5	The tubes are constantly in the dew-point state, and accordingly, S-TEN is highly effective. S-TEN 1 tube is most suitable for such application.
Flue	Duct, expansion	○	○	4.5~9	S-TEN of the no coating specifications or the acid resistant-coating specifications is suitable. When the temperature of the flue gas itself drops below the dew point, drainage accumulates in the flue bottom, frequently causing unexpectedly severe corrosion, and thus it is recommended to provide appropriate measures to carry out sufficient drainage and to prevent lowering of steel plate temperatures by means of external heat insulation.
Stack	Internal cylinder	○	—	6~12	
Flue-gas desulfurizer	Flue-gas cylinder, after-burner duct	○	○	3.2~6	In the ducts leading to and from gas coolers and absorption towers, low pH solutions occasionally adhere to wall surfaces due to sulfuric acid mist, and therefore it is necessary to fully investigate drainage conditions.
Hydrochloric acid pickling tank	Tank	○	—	9~20	The use for hydrochloric acid pickling tank in coating is suitable. S-TEN tanks have a high scratch resistance during use, and these tanks after use can be treated as the general recyclable steel material.



**Precaution in the Use of S-TEN**

- 1) S-TEN are a group of low-alloy corrosion-resistant steels. It should be noted that despite dew point corrosion being inhibited in them, there still occurs rust formation and progress of corrosion also.
- 2) S-TEN, as shown in Fig. 1.6, are effective in inhibiting sulfuric acid dew point corrosion, as compared with other steel grades, but, as can be seen from their performance at 60°C and 70°C in this figure, there are temperature regions in which steels' absolute corrosion weight losses become greater than those in the other temperature regions.
- 3) Careful note must be taken of the fact that S-TEN also tend to be more greatly susceptible to high-temperature corrosion and low-concentration sulfuric acid corrosion, than to corrosion occurring in the gas-liquid equilibrium state, as shown in Fig. 1.8.
- 4) Results of the corrosion test made at very thin concentrations of pH<sub>2</sub> to 4 of sulfuric acid are shown in Table 1.8. As against corrosion by such weakly acidic or neutral liquid, stainless steels are most resistant, with very little corrosion weight loss. At concentrations of pH<sub>3</sub> and over, there is no significant difference between ordinary steels and S-TEN.

**Fig. 1.8 Corrosion behaviors of S-TEN in non-equilibrium regions**

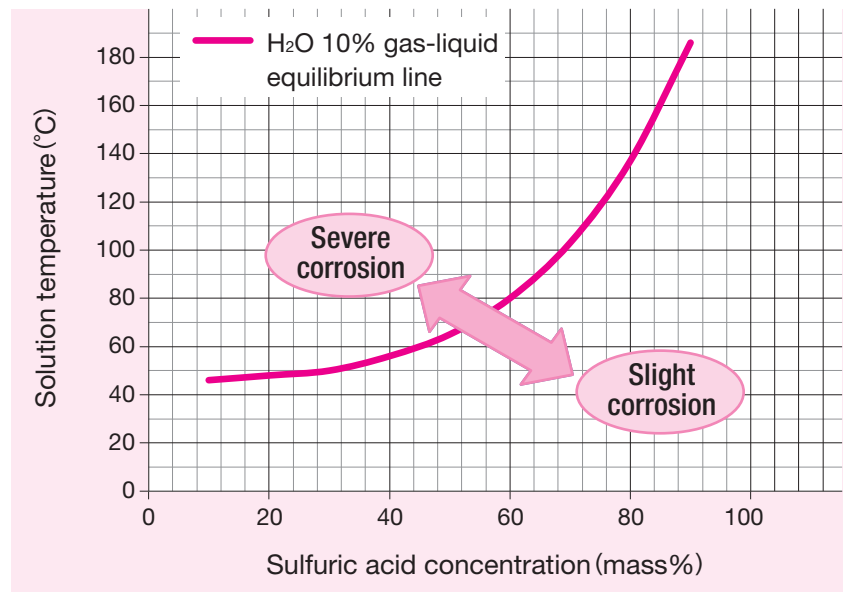

**Table 1.8 Results of corrosion tests in the weakly acidic area (pH<sub>2</sub> to 4)**

Grade	Corrosion rate (mg/cm <sup>2</sup> /hrs)			Testing conditions
	pH <sub>2</sub>	pH <sub>3</sub>	pH <sub>4</sub>	
<b>S-TEN 1</b>	<b>1.6</b>	<b>2.0</b>	<b>0.36</b>	Test temperature: 30°C Relative speed of specimen and solution: 1.8 m/sec Test time: 72 hrs
<b>S-TEN 2</b>	<b>2.8</b>	<b>2.2</b>	<b>0.38</b>	
Mild Steel	8.2	2.5	0.36	
SUS 304	<0.001	<0.001	<0.001	
SUS 316	<0.001	<0.001	<0.001	
SUS 410	0.51	<0.001	<0.001	
SUS 430	0.001	<0.001	<0.001	

## 2. Specifications and Available Sizes of S-TEN

### Specifications of S-TEN

#### ① Grade Designation

Table 2.1

Grade	Product	Thickness [diameter] (mm)
S-TEN 1	Cold-rolled sheet	$0.6 \leq t \leq 2.3$
	Hot-rolled sheet and plate <sup>1)</sup>	$1.6 \leq t \leq 20.2$
	ERW pipe and tube <sup>2)</sup>	Outside dia.: 19.0~114.3 Wall thickness: 2.0~8.9
	Seamless pipe and tube <sup>2)</sup>	Outside dia.: 31.8~426 Wall thickness: 3.0~50
	Large-diameter pipe	Outside dia.: 400~2,500 Wall thickness: 6.0~20
S-TEN 2	Cold-rolled sheet	$0.6 \leq t \leq 2.3$
	Hot-rolled sheet and plate <sup>1)</sup>	$1.6 \leq t \leq 25.4$
	Bar and bar-in-coil	$t \leq 38$

Notes 1) Hot-rolled sheets and plates (all plates; specification required for sheet) conform to JIS G 3106 (S-TEN 1: SM400A; S-TEN 2: SM490A). JIS is inscribed on the steel product inspection sheet when specified.

2) ERW pipe and tubes are registered in the technical standards for thermal power generation facilities (METI KA-STB380J2, KA-STPT380J2), ASME Code Case 2494 and ASTM A423.

#### ② Chemical Composition

Table 2.2

Grade	Chemical composition (%)								
	C	Si	Mn	P	S	Cu	Cr	Ti	Sb
S-TEN 1	$\leq 0.14$	$\leq 0.55$	$\leq 1.60^{1)}$	$\leq 0.025$	$\leq 0.025$	0.25~0.50	—	—	$\leq 0.15$
S-TEN 2	$\leq 0.14$	0.15~0.55	$\leq 1.60$	$\leq 0.035$	$\leq 0.035$	0.25~0.50	0.50~1.00	$\leq 0.15$	—

Notes 1)  $2.5 \times [C] \leq Mn$

2) Alloying elements other than those shown in the table may added as occasion demands

#### ③ Mechanical Properties

Table 2.3 Cold-rolled Sheets and Bars

Grade	Thickness (mm)	Yield point (N/mm <sup>2</sup> )	Tensile strength (N/mm <sup>2</sup> )	Elongation (%)	Test specimen (JIS)
S-TEN 1	—	$235 \leq$	$400 \leq$	$23 \leq$	No. 5
S-TEN 2	—	$325 \leq$	$440 \leq$	$22 \leq$	No. 5 <sup>1)</sup>

Note 1) Bars: No. 2 for the diameters 25 mm or less; No. 14A for the diameters more than 25 mm

Table 2.4 Hot-rolled Sheets and Plates, and Spiral Welded Pipe

Grade	Thickness (mm)	Yield point (N/mm <sup>2</sup> )	Tensile strength (N/mm <sup>2</sup> )	Elongation (%)	Test specimen (JIS)
S-TEN 1	$\leq 5$	$245 \leq$	400~510	$23 \leq$	No. 5
	$\leq 16$			$23 \leq$	No. 5
	$\leq 20.2$	$235 \leq$		$18 \leq$	No. 1A <sup>1)</sup>
				$23 \leq$	No. 5
S-TEN 2	$\leq 5$	$325 \leq$	490~610	$22 \leq$	No. 5
	$\leq 16$			$22 \leq$	No. 5
				$17 \leq$	No. 1A <sup>1)</sup>
	$\leq 25.4$	$315 \leq$		$22 \leq$	No. 5
				$21 \leq$	No. 1A <sup>1)</sup>

Note 1) Applied in the case of production as JIS G 3106 (applied in all production of plates)

Table 2.5 ERW Pipes and Tubes, Seamless Pipes and Tubes

Grade	Thickness (mm)	Yield point (N/mm <sup>2</sup> )	Tensile strength (N/mm <sup>2</sup> )	Elongation (%)	Test specimen (JIS)
S-TEN 1	—	$230 \leq$	$380 \leq$	$35 \leq^{1)}$	No. 11 or 12
				$30 \leq$	No. 4 (pipe axis direction)

Note 1) Minimum elongation values for No.12 test piece (pipe axis direction) taken from pipes under 8mm in wall thickness

Elongation value by thickness division						
$1 < t \leq 2\text{mm}$	$2 < t \leq 3\text{mm}$	$3 < t \leq 4\text{mm}$	$4 < t \leq 5\text{mm}$	$5 < t \leq 6\text{mm}$	$6 < t \leq 7\text{mm}$	$7 < t < 8\text{mm}$
26	28	29	30	32	34	35

(Unit : %)

## 2. Specifications and Available Sizes of S-TEN

### Available Sizes for S-TEN

#### ① Hot-rolled Sheets and Plates (S-TEN 1, S-TEN 2)

Plate Thickness (mm)	Width (mm)	500	1,000	1,500	2,000	2,500	3,000	3,500	4,000	4,500		
		600	1,250	1,350	1,550	2,400	3,000	3,200	3,400	3,600	4,000	4,500
1.6 ≤ t ≤ 2.0												
2.0 < t ≤ 2.5			3.6									
2.5 < t ≤ 3.0			3.6									
3.0 < t ≤ 4.5			6.0									
4.5 < t ≤ 5.0			9.7	16	16							
5.0 < t ≤ 6.0			9.7	16	16							
6 < t ≤ 7					20							
7 < t ≤ 8					20							
8 < t ≤ 9					20							
9 < t ≤ 12					23m							
12 < t ≤ 25.4					23m							

Notes 1) Figures in the table show the maximum length.

2) Minimum length: 3 m for the thicknesses 6 mm or more; 1.5 m for the thicknesses less than 6 mm

3)  For this size range and the plate thicknesses up to 50 mm, please consult us in advance.

#### ② Cold-rolled Sheets (S-TEN 1, S-TEN 2)

Plate Thickness (mm)	Width (mm)	400	600	800	1,000	1,200	1,400	1,600	1,800	2,000	
		290	530				1,470	1,540	1,845		
0.6, 0.7											
0.8, 0.9, 1.0, 1.2, 1.6			16		Length : 0.79~4.92m				0.8		
2.0, 2.3											

Note)  For this size range, please consult us in advance.

#### ③ ERW Pipes and Tubes (S-TEN 1)

Outside diameter (mm)	Nominal diameter A	Wall thickness (mm)														
		2.0	3.0	4.0	5.0	6.0	7.0	8.0	9.0	10.0	11.0~	25.4				
19.0					4.5											
21.7	15															
25.4																
27.2	20															
31.8																
34.0	25															
38.1																
42.7	32															
45.0																
48.6	40															
50.8																
54.0																
57.0																
60.5	50															
76.2	65															
88.9	80															
101.6	90															
114.3	100															

Note) The following sizes are subject to negotiation. Available products are SAW pipe (BR or SP). Outside diameter (nominal diameter A): 138.9-125, 165.2-150, 216.3-200, 267.4-250, 318.5-300, 355.6-350, 406.4-400; maximum outside diameter: 2,500 mm

## 2. Specifications and Available Sizes of S-TEN

### Available Sizes for S-TEN

#### ④ Seamless Pipes and Tubes (S-TEN 1)

Outside diameter (mm)	Wall thickness (mm)																													
	2.0	3.0	4.0	5.0	6.0	7.0	8.0	9.0	10.0	12.0	14.0	16.0	18.0	20.0	22.0	24.0	26.0	28.0	30.0	32.0	34.0	36.0	38.0	40.0	42.0	44.0	46.0	48.0	50.0	
31.8		3.0																												
38.1																														
42.7																														
50.8			3.5																											
60.5																														
70.0																														
80.0			4.0																											
101.6																														
114.3																														
127.0																														
141.3																														
168.3																														
180.0																														
203.0																														
219.1																														
241.8																														
254.0																														
267.4																														
273.1																														
305.0																														
318.5																														
323.9																														
325.0																														
339.7																														
355.6																														
368.0																														
381.0																														
406.4																														
426.0																														

# 3.Characteristic Properties of S-TEN (Examples)

## Chemical Composition and Mechanical Properties

### ① Chemical Composition

Table 3.1 Chemical Composition (Example)

Grade	Product	Chemical composition (%)							
		C	Si	Mn	P	S	Cu	Cr	Others
S-TEN 1	Cold-rolled sheet	0.04	0.30	0.91	0.015	0.010	0.30	—	Sb : 0.10
	Hot-rolled medium plate	0.04	0.30	0.91	0.015	0.010	0.30	—	Sb : 0.10
	Plate	0.04	0.28	1.00	0.012	0.012	0.28	—	Sb : 0.09
	ERW pipe and tube	0.04	0.20	1.00	0.011	0.010	0.27	—	Sb : 0.10
	Seamless pipe and tube	0.03	0.25	1.12	0.006	0.014	0.29	—	Sb : 0.12
S-TEN 2	Cold-rolled sheet	0.09	0.24	0.76	0.017	0.013	0.32	0.68	Ti : 0.03
	Hot-rolled medium plate	0.12	0.26	0.76	0.016	0.007	0.28	0.70	Ti : 0.03
	Plate	0.14	0.22	0.75	0.018	0.012	0.34	0.65	Ti : 0.03

### ② Mechanical Properties

Table 3.2 Hot-rolled Sheets and Plates

Grade	Plate thickness (mm)	Tensile test		
		Yield point (N/mm <sup>2</sup> )	Tensile strength (N/mm <sup>2</sup> )	Elongation (%)
S-TEN 1	2.3	345	470	36
	6.0	383	458	38
	12.0	382	452	42
	16.0	368	441	47
S-TEN 2	2.3	440	540	33
	6.0	440	530	35
	9.0	420	520	39
	13.0	410	510	41

Test specimen: JIS No. 5

Table 3.3 Cold-rolled Sheets

Grade	Plate thickness (mm)	Tensile test		
		Yield point (N/mm <sup>2</sup> )	Tensile strength (N/mm <sup>2</sup> )	Elongation (%)
S-TEN 1	1.2	295	410	36
	1.6	305	440	36
S-TEN 2	0.8	380	490	32
	1.2	380	490	32

Table 3.4 ERW Pipes and Tubes

Grade	Outside diameter × Wall thickness (mm)	Tensile test		
		Yield point (N/mm <sup>2</sup> )	Tensile strength (N/mm <sup>2</sup> )	Elongation (%)
S-TEN 1	48.6 × 3.5	298	403	61
	89.1 × 5.0	293	418	41

Table 3.5 Seamless Pipes and Tubes


Grade	Outside diameter × Wall thickness (mm)	Tensile test		
		Yield point (N/mm <sup>2</sup> )	Tensile strength (N/mm <sup>2</sup> )	Elongation (%)
S-TEN 1	50.8 × 8.0	319	440	58
	219.1 × 15.1	300	414	56

## High-temperature Characteristics

### High-temperature Short-time Strength

Results of high-temperature tensile tests are shown in Fig. 3.1.

Fig. 3.1 High-temperature Tensile Test Results

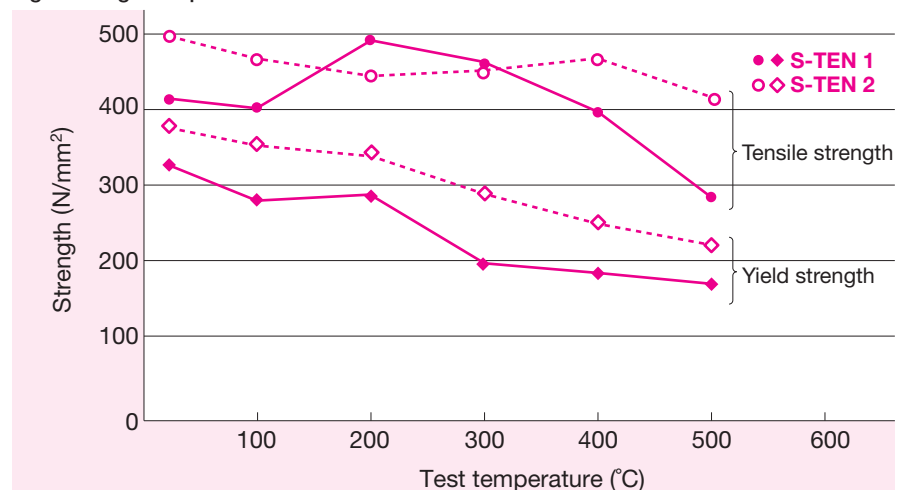

### 3. Characteristic Properties of S-TEN (Examples)

#### Physical Properties

Physical properties are shown in Table 3.6. Specific heat, thermal conductivity and thermal expansion coefficient of S-TEN are similar to those of Mild Steel, SM400A, SM490C, etc.

Table 3.6 Physical Properties

Grade	Temperature (°C)	Young's modulus (GPa)	Specific heat (kJ/kg·K)	Thermal conductivity (W/m·K)	Thermal expansion coefficient 20°C~T (×10 <sup>-6</sup> /°C)
S-TEN 1	25	207.4	0.450	44.2	—
	100	203.7	—	—	12.8
	200	198.3	0.491	45.5	13.2
	300	192.0	—	—	13.6
	400	184.0	0.532	36.8	14.0
	500	—	—	—	—
S-TEN 2	25	211.0	0.456	45.1	—
	100	207.0	0.486	41.2	12.8
	200	202.0	0.520	40.8	13.1
	300	196.0	0.553	40.2	13.5
	400	188.0	0.590	37.7	13.8
	500	179.0	0.644	34.1	14.2

Measurement method — Young's modulus: Resonance method; Specific heat and thermal conductivity: Laser flash method; Thermal expansion coefficient: Measurement of thermal expansion

#### Corrosion Resistance ① Weather Resistance

S-TEN surpasses ordinary steel in weather resistance:

S-TEN 1: About 2 times (similar to Cu-containing steel)

S-TEN 2: 4~6 times (similar to COR-TEN 490)

Table 3.7 Chemical Composition of Test Specimens for Hydrochloric Acid Resistant Tests (Figs. 3.2~3.5)

Grade	Chemical composition (%)								
	C	Si	Mn	P	S	Cu	Cr	Sb	Ti
S-TEN 1	0.03	0.26	0.90	0.011	0.010	0.27	—	0.09	—
S-TEN 2	0.09	0.24	0.69	0.009	0.014	0.29	0.54	—	0.03
Mild Steel	0.15	0.14	0.70	0.014	0.005	0.01	—	—	—

#### ② Hydrochloric Acid Resistance

Corrosion caused by hydrochloric acid gas contained in the exhaust gas of garbage disposal incinerators has recently become a social problem. S-TEN 1 has greater resistance to hydrochloric acid corrosion than ordinary steel, and thus permits effective application in this field (for example, hydrochloric acid tanks for galvanizing). Figs. 3.2~3.5 show the results of tests pertaining to hydrochloric acid corrosion.

- 1) S-TEN 1 exhibits corrosion resistance 5~10 times that of ordinary steel.
- 2) In dilute hydrochloric acid (about 3% or less), the corrosion rate of S-TEN is higher than that of SUS, and thus the use of S-TEN in such environments is not recommended.
- 3) In hydrochloric acid with a concentration of 10% or more, S-TEN 1 exhibits high corrosion resistance.
- 4) As the temperature and concentration of hydrochloric acid increases, S-TEN 1 exhibits higher corrosion resistance.
- 5) Please pay attention to the fact that when alien substances are mixed in the acid, characteristic properties may vary in some cases.

### 3. Characteristic Properties of S-TEN (Examples)

Fig. 3.2 Relation between Hydrochloric Acid Concentration and Corrosion Rate

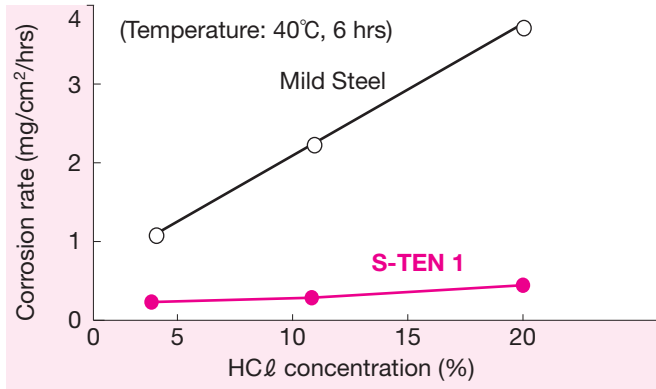


Fig. 3.3 Relation between Hydrochloric Acid Concentration and Corrosion Rate

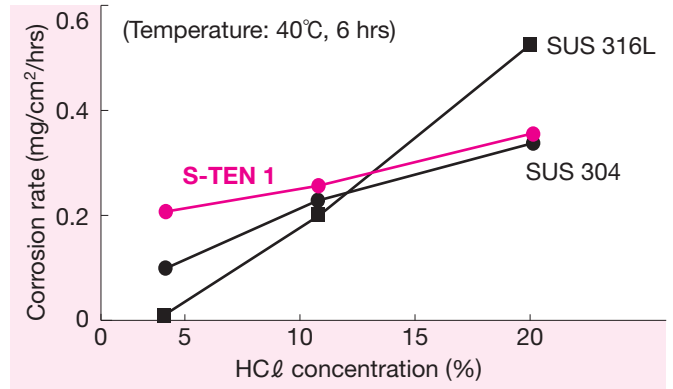


Fig. 3.4 Relation between Hydrochloric Acid Concentration and Corrosion Rate



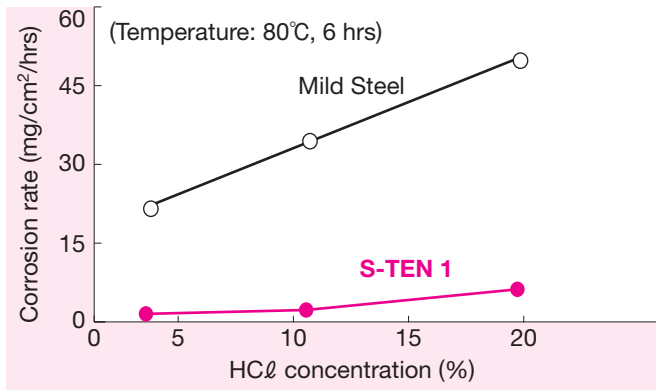


Fig. 3.5 Relation between Hydrochloric Acid Concentration and Corrosion Rate

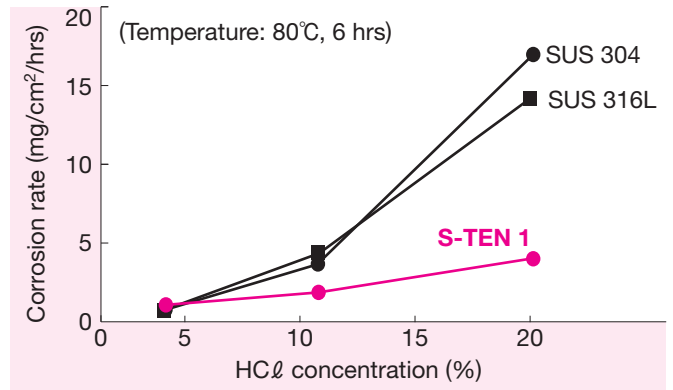

#### ③ Sulfuric Acid Resistance

Fig. 3.6 Sulfuric Acid Resistance of Various Steel Products (50%, 70°C, H<sub>2</sub>SO<sub>4</sub>)

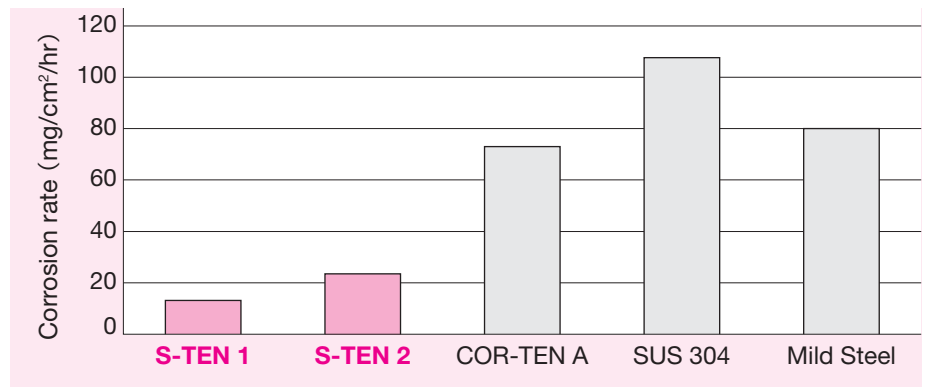


#### ④ Appearance of Various Steel Products after Accelerated Corrosion Tests

Photo 3.1 10.5% Hydrochloric Acid, 60°C, 72 Hrs



(Initial size of test specimen : 4t × 25 × 25 mm)

Photo 3.2 10.5% Hydrochloric Acid, 80°C, 144 Hrs

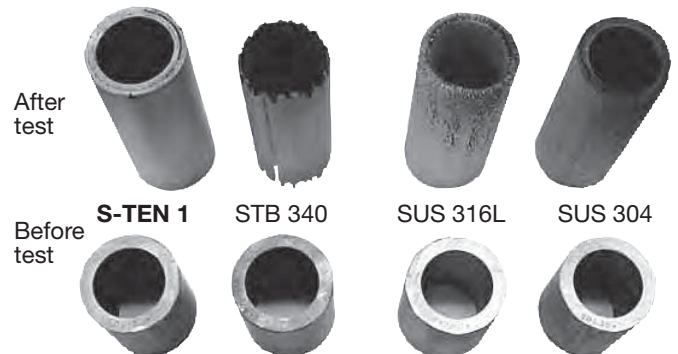

## 4. Welding of S-TEN

The carbon and manganese contents of S-TEN are kept low to secure high corrosion resistance. Therefore, S-TEN offers excellent weldability and can be welded under the same conditions as those for ordinary steel of the same strength level.

However, because sulfuric acid and hydrochloric acid dew-point corrosion resistance similar to that of the base metal is required for welds, it is necessary to use welding materials for exclusive use for S-TEN.

### Welding Materials

As the welding material for exclusive use for S-TEN, Nippon Steel & Sumikin Welding Co., Ltd.\* supplies the following products.

\*Inquiry: Nippon Steel & Sumikin Welding Co., Ltd.  
Shingu Bldg., 2-4-2 Toyo, Koto-ku, Tokyo 135-0016  
Tel: +81-3-6388-9000 Fax: +81-3-6388-9160  
www.welding.nssmc.com

#### ① Welding Materials

Table 4.1

Grade	Kind of shielding material			
	Shielded metal arc welding (SMAW)	Gas shielded metal arc welding		Submerged arc welding (SAW)
		MAG welding (FCAW)	TIG welding (GTAW)	
<b>S-TEN 1</b>	NSSW ST-16M <sup>1)</sup> ☆(JIS Z 3211 E4916-G)	NSSW SF-1ST ☆(JIS Z 3313 T49J0T1-1CA-UH5) (AWS S-36 E81T1-C1A0-G)	NSSW YT-1ST ☆(JIS Z 3313 T49J0TG-1GA-U)	NSSW Y-1ST × NSSW NB-1ST ☆(JIS Z 3183 S502-H)
<b>S-TEN 2</b>	NSSW ST-16Cr <sup>1)</sup> ☆(JIS Z 3211 E5516-G)	NSSW FC-23ST ☆(JIS Z 3313 T49J0T1-1CA-U)	—	—
	NSSW ST-03Cr <sup>2)</sup> ☆(JIS Z 3211-E4903-G)			

Notes 1) Low-hydrogen type 2) Lime titania type

Mark "☆" means that the product meets the classification requirements but that the JIS Mark system is not applicable to the classification.

#### ② Chemical Composition and Mechanical Properties of Various Welding Materials (Example)

Table 4.2

Welding method	Brand	C	Si	Mn	P	S	Cu	Cr	Sb	YS (N/mm <sup>2</sup> )	TS (N/mm <sup>2</sup> )	EL (%)	vE <sub>0</sub> (J)
SMAW	NSSW ST-16M	0.04	0.62	0.50	0.009	0.004	0.42	—	0.08	471	568	29	165
	NSSW ST-16Cr	0.05	0.50	0.48	0.012	0.006	0.20	0.73	—	481	550	27	203
	NSSW ST-03Cr	0.06	0.15	0.56	0.014	0.011	0.23	0.79	—	463	532	26	112
FCAW	NSSW SF-1ST	0.05	0.60	1.41	0.012	0.013	0.39	—	0.10	581	640	25	71
	NSSW FC-23ST	0.04	0.38	0.81	0.016	0.013	0.35	0.74	—	512	585	25	52
GTAW	NSSW YT-1ST	0.01	0.29	1.33	0.004	0.009	0.32	—	0.10	398	478	39	285
SAW	NSSW Y-1ST × NSSW NB-1ST	0.03	0.34	1.13	0.007	0.011	0.19	—	0.09	452	530	31	141

#### ③ Welding Materials for Dissimilar Welding with Stainless Steels (Example)

Table 4.3

Welding method	Brand	C	Si	Mn	P	S	Cr	Ni	YS (N/mm <sup>2</sup> )	TS (N/mm <sup>2</sup> )	EL (%)	vE <sub>0</sub> (J)
SMAW	NSSW 309-R	0.06	0.33	1.51	0.020	0.006	24.2	13.2	460	582	37	64
SAW	NSSW Y-309 × NSSW BF-300M	0.06	0.45	1.64	0.020	0.010	24.0	13.5	375	558	38	89
FCAW	NSSW SF-309L	0.03	0.65	1.54	0.023	0.009	24.4	12.7	429	566	37	36
GMAW	NSSW YM-309	0.05	0.35	1.74	0.021	0.007	23.6	13.3	447	618	33	92
GTAW	NSSW YT-309	0.05	0.40	1.65	0.020	0.006	23.8	12.4	517	620	34	166

• Please pay attention to galvanic corrosion.



## Welding Characteristics

Maximum hardness tests and y-groove weld cracking tests prescribed by JIS were performed to confirm the weldability of S-TEN. S-TEN 1 and 2 having the characteristics shown in Tables 4.4 and 4.5 were used as the test specimens.

Table 4.4 Chemical Composition of Test Specimens

Grade	Thickness (mm)	Chemical composition (%)								
		C	Si	Mn	P	S	Cu	Cr	Ti	Sb
S-TEN 1	16	0.04	0.28	1.00	0.012	0.012	0.28	—	—	0.09
S-TEN 2	16	0.09	0.21	0.74	0.023	0.010	0.35	0.70	0.02	—

Table 4.5 Mechanical Properties of Test Specimens

Grade	Thickness (mm)	Tensile test		
		Yield point (N/mm <sup>2</sup> )	Tensile strength (N/mm <sup>2</sup> )	Elongation (%)
S-TEN 1	16	368	441	47
S-TEN 2	16	380	500	43

Tensile test specimen: JIS No. 5

### ① Maximum Hardness Test

Table 4.6 shows the results of HAZ maximum hardness tests in accordance with JIS Z 3101 (Testing Method of Maximum Hardness in Weld Heat-Affected Zone).

Table 4.6 Maximum Hardness Test Results

Grade	Thickness (mm)	Initial temperature of specimen	Maximum hardness (Hv)
S-TEN 1	16	Room temperature	189
S-TEN 2	16	Room temperature	242

Welding conditions: Welding Electrodes 4 mm in dia.; current 170 A; voltage 24 V; speed 150 mm/min

### ② y-groove Cracking Test

To determine the crack sensitivity of welds, the test was conducted using the test specimens, shown in Fig. 4.1, in accordance with JIS Z 3158 (Method of y-Groove Cracking Test). The test results are shown in Table 4.7.

Fig. 4.1 Configuration of y-groove Weld Cracking Test Specimen

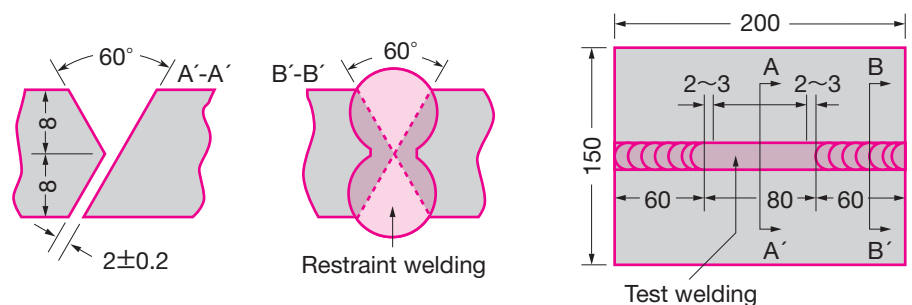


Table 4.7 y-groove Weld Cracking Test Results

Grade	Thickness (mm)	Initial temperature of specimen (°C)	Surface crack rate (%)				Section crack rate (%)				Root crack rate (%)			
			1	2	3	Average	1	2	3	Average	1	2	3	Average
S-TEN 1	16	0	0	0	0	0	0	0	0	0	0	0	0	0
		25	0	0	0	0	0	0	0	0	0	0	0	0
S-TEN 2	16	0	0	0	0	0	0	0	0	0	0	0	0	0
		25	0	0	0	0	0	0	0	0	0	0	0	0

Welding conditions: Welding Electrodes 4 mm in dia.; current 170 A; voltage 24 V; speed 150 mm/min

## 4. Welding of S-TEN

### Sulfuric Acid and Hydrochloric Acid Resistance of Welded Joints


Sulfuric acid and hydrochloric acid immersion test of welded joints was conducted to determine the sulfuric acid resistance of welded joints, the results of which are shown below.

The test results indicate that the welded joints made using welding rods for exclusive use for S-TEN exhibit corrosion resistance similar to that of the base metal. But in the case of using welding rods for use for mild steel, the results clearly indicate that the welded joints only are severely corroded.

#### ① Example of S-TEN 1

Immersion tests were conducted using the test specimen, consisting of both base metal and weld metal, shown in Fig. 4.2 and under the conditions shown in Photo 4.1. Cross sections of the corroded specimen are shown in Photo 4.1.

Fig. 4.2 Configuration of Sulfuric Acid Immersion Test Specimen

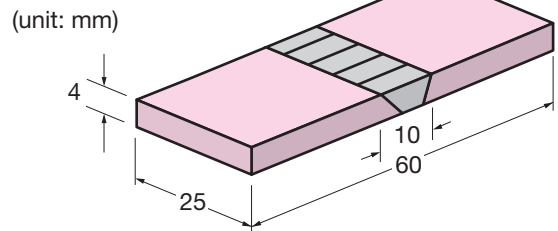

Sulfuric acid: 50% sulfuric acid × 70°C × Immersion for 24 hrs

Photo 4.1 Corrosion Conditions of S-TEN 1 Weld Joint

Hydrochloric acid: 10.5% hydrochloric acid × 80°C × Immersion for 24 hrs

NSSW-16 (Low hydrogen-type welding rod for mild steel) × Base metal (Mild Steel)




NSSW ST-16M (Welding rod for exclusive use for S-TEN 1) × Base metal (S-TEN 1)



NSSW-16 (Low hydrogen-type welding rod for mild steel) × Base metal (Mild Steel)



NSSW ST-16M (Welding rod for exclusive use for S-TEN 1) × Base metal (S-TEN 1)




#### ② Field Test Results

Immersion condition: 17.5% hydrochloric acid, 32°C, fully immersed  
Immersion period: 4 months


Photo 4.2 Cross Sections of Joint Specimens Immersed in Hydrochloric Acid Pickling Tank for 4 Months

Base metal × Weld metal

Mild Steel × NSSW-16 (Low hydrogen-type welding rod for mild steel)

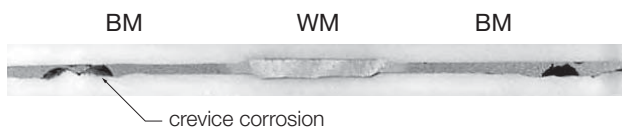


S-TEN 1 × ST-16M (Welding rod for exclusive use for S-TEN 1)



BM: Base metal: WM: Weld metal

Fig. 4.3 Test Results for Weld Joint Test Specimens Immersed in Hydrochloric Acid Pickling Tank

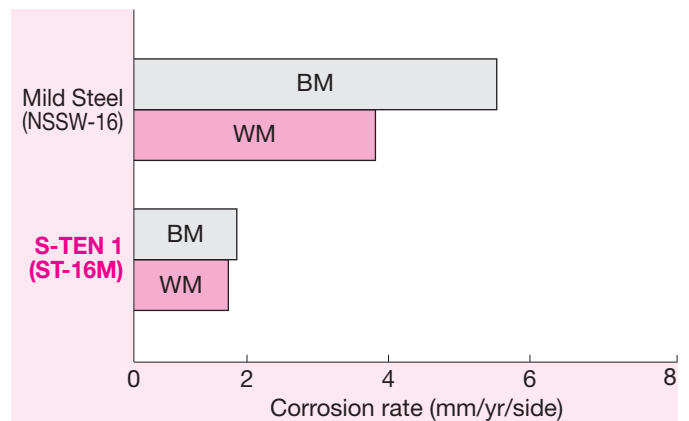


BM: Base metal: WM: Weld metal

## Galvanic Corrosion in Corrosive Atmosphere

Galvanic corrosion is caused by the difference in electrical potential between different metals.

S-TEN 1 and Mild Steel show the trend of natural electrode potential in a 40% sulfuric acid solution at 60°C, as shown in Fig. 4.4. In other words, S-TEN 1 shows 20 mV higher potential than Mild Steel. Therefore, joining of Mild Steel with S-TEN 1 would make Mild Steel a cathode and the corrosion of S-TEN 1 (anodic dissolution) would be accelerated. It has been confirmed, however, that such slight difference in potential is practically insignificant, as introduced below.

Fig. 4.4 Natural Electrode Potentials of S-TEN 1 and Mild Steel in 40% Sulfuric Acid (60°C)

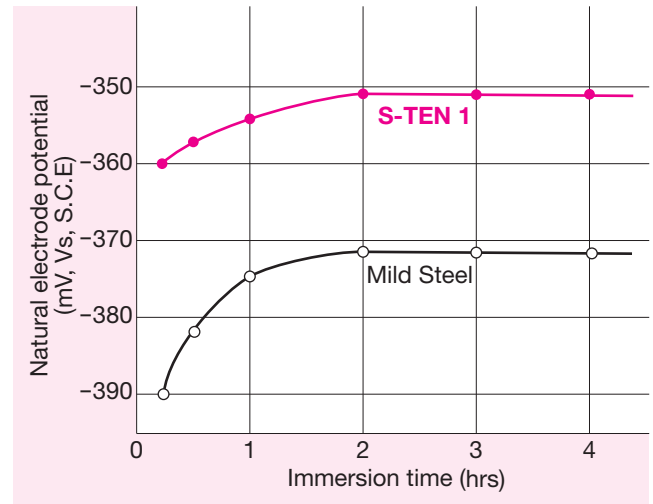

## Property Qualification Test Results

### S-TEN 1

The following property qualification tests were conducted in the laboratory. In preparing test specimens, it was thought that corrosion of Mild Steel would be accelerated when the area of Mild Steel was less than that of S-TEN 1. Taking this into account, the test specimens were prepared so that the ratio of the area of Mild Steel to S-TEN 1 became 1:1 and 1:10 for butt-welded joints.

The tests were conducted by immersing the specimens in 40%-concentrated sulfuric acid at 55°C for 5 hours. As a result, as shown in Figs. 4.5 and 4.6, it was found that the corrosion of specimens was nearly the same as that of S-TEN 1 itself and that, in such sulfuric-acid corrosive environment, contact of different metals with an electrical potential difference of approximately 20 mV can be disregarded.

Fig. 4.5 Corrosion Mass of S-TEN 1 / Different Material Weld Joint (Area ratio 1:1)


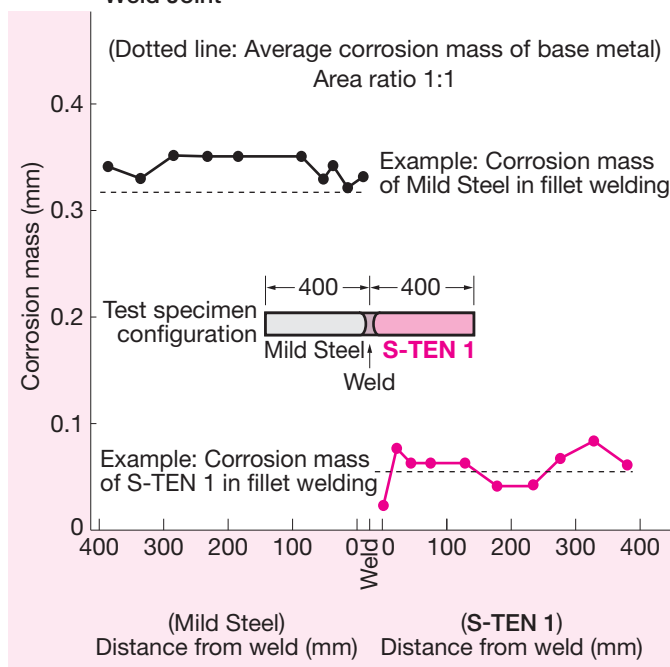


Fig. 4.6 Corrosion Mass of S-TEN 1 / Different Material Weld Joint (Area ratio 1:10)




# 5. Application Examples

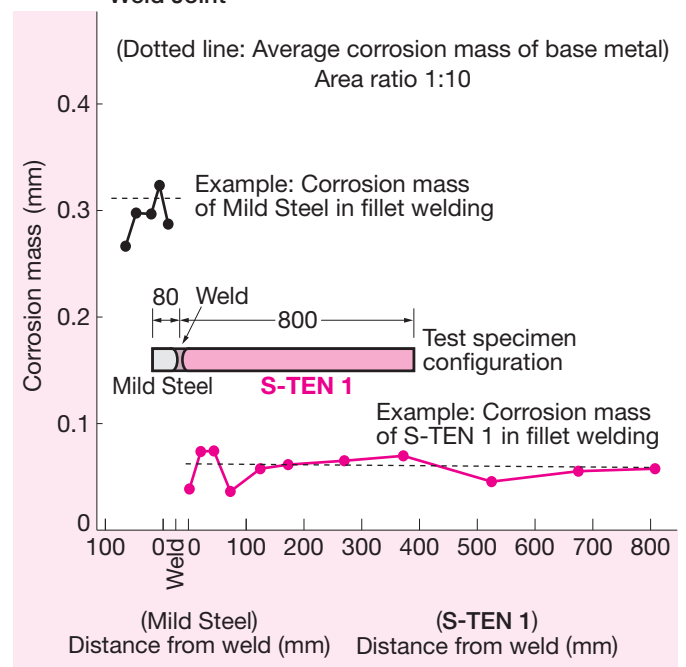

Kashima Kyodo Electric Power



Boiler Building

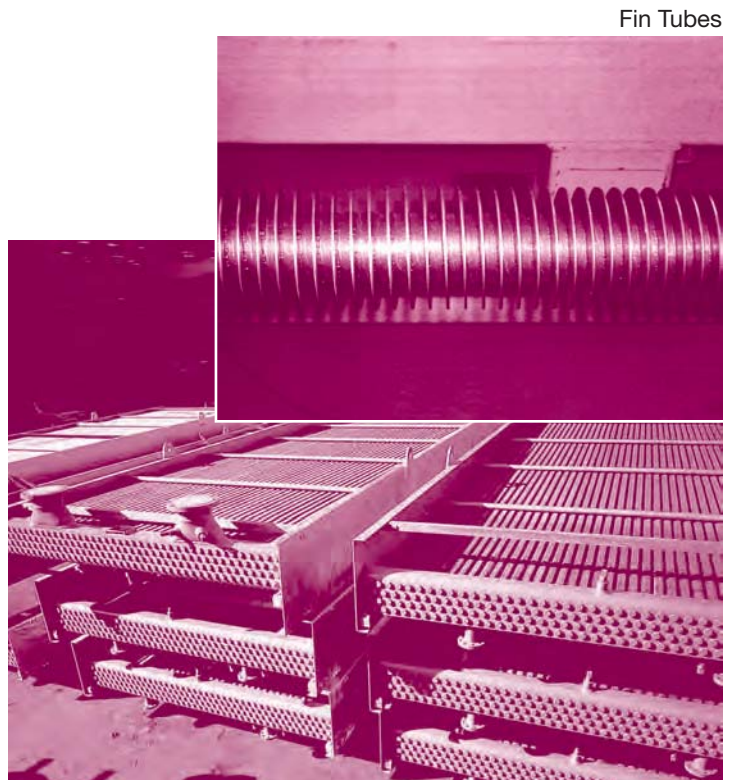

Fin Tubes

Tubes for Air Fin Cooler

# 6. Reference

## Unit Conversion Table

°C	°F	N/mm <sup>2</sup>	ksi	mm	mil	inch	ft
20	68	100	689	0.1	3.94	0.003937008	
40	104	200	1379	0.2	7.87	0.007874016	
60	140	250	1724	0.3	11.81	0.011811024	
80	176	300	2068	0.4	15.75	0.015748031	
100	212	350	2413	0.5	19.69	0.019685039	
120	248	400	2758	1	39.37	0.039370	
140	284	450	3103	2	78.74	0.078740	
160	320	460	3172	3	118.11	0.118110	
180	356	470	3241	4	157.48	0.157480	
200	392	480	3309	5	196.85	0.196850	
300	572	490	3378	10	393.70	0.393701	
400	752	500	3447	20	787.40	0.787402	
500	932	510	3516	30		1.181102	
		520	3585	40		1.574803	0.13123
		530	3654	50		1.968504	0.16404
		540	3723	100		3.937008	0.32808
		550	3792	200		7.874016	0.65617
		560	3861	300		11.81102	0.98425
		570	3930	400		15.74803	1.31234
		580	3999	500		19.68504	1.64041995
		590	4068	1000		39.37008	3.2808399
		600	4137	2000		78.74016	6.56167979
		610	4206	3000			9.84251969
		620	4275	4000			13.1234
		630	4344	5000			16.4041995
		640	4413	6000			19.6850

F = 9/5 × C + 32


1 ksi = 0.145038 N/mm<sup>2</sup>

1 mil = 0.0254 mm    1 inch = 25.4 mm    1 ft = 304.8 mm


## 6. Reference

### Unit Conversion Charts


Temperature (°C vs °F)

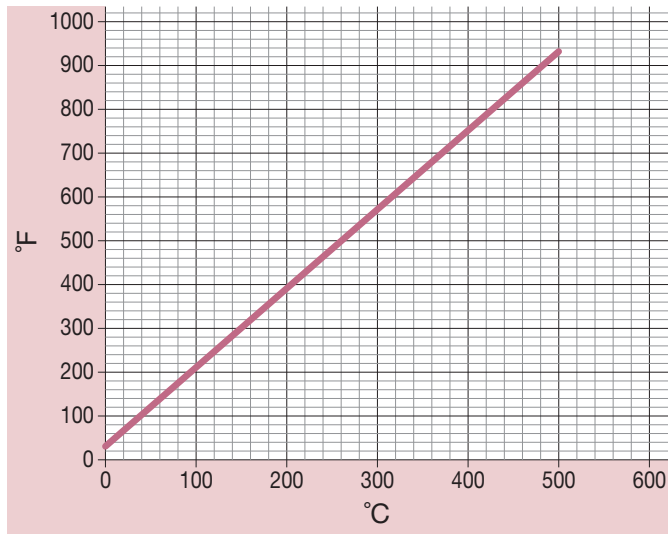


Stress (N/mm<sup>2</sup> vs ksi)

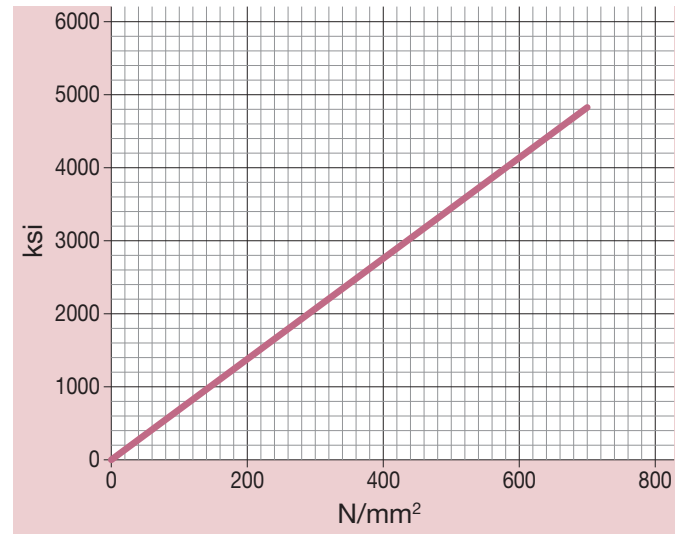


Length (mm vs mil)

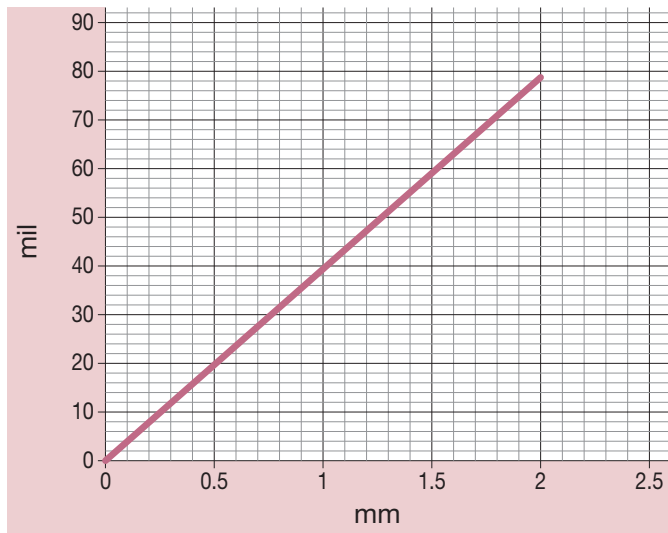

Length (mm vs inch)

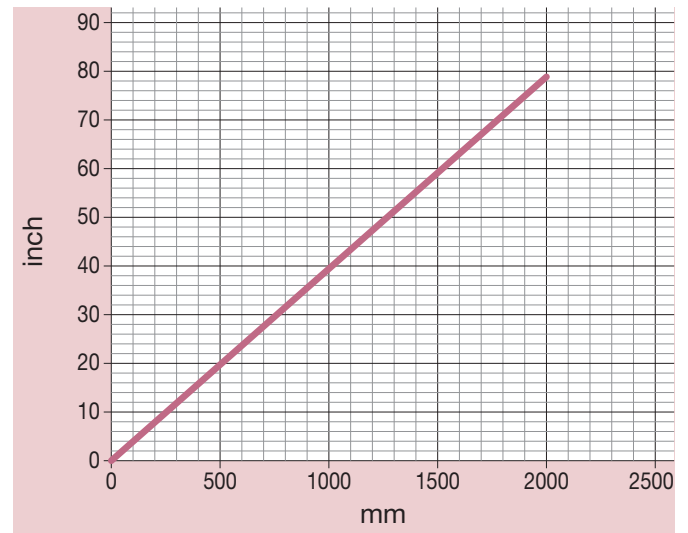

Length (mm vs ft)

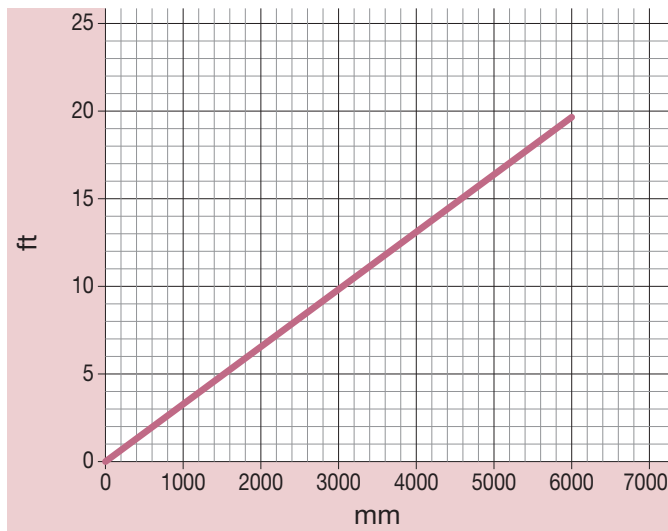



# NIPPON STEEL & SUMITOMO METAL

<http://www.nssmc.com/>



**NIPPON STEEL &  
SUMITOMO METAL**

**Nippon Steel & Sumitomo Metal Corporation**

2-6-1 Marunouchi, Chiyoda-ku, Tokyo 100-8071 Japan  
Tel: +81-3-6867-4111

Sulfuric Acid and Hydrochloric Acid Dew-point Corrosion-resistant Steel S-TEN™  
A012en\_06\_201803f

© 2007, 2018 NIPPON STEEL & SUMITOMO METAL CORPORATION